


**LRP16GE****Residential - Two-Stage Compressor - Variable Speed Blower****PRODUCT SPECIFICATIONS**

Bulletin No. 210773

November 2016

Supersedes July 2016

**SEER - 16.00****AFUE - 81%****2 to 5 Tons****Cooling Capacity - 23,800 to 57,000 Btuh****Input Gas Heating Capacity - 72,000 to 126,000 Btuh****MODEL NUMBER IDENTIFICATION****L RP 16 GE 36 - 090 X P - 1 - A**

**Brand**  
L = Lennox

**Product Type**  
RP = Residential Packaged Unit

**Nominal SEER**  
16 = 16 SEER

**Unit Type**  
GE = Gas/Electric Unit

**Nominal Cooling Capacity**  
24 = 2 tons  
36 = 3 tons  
48 = 4 tons  
60 = 5 tons

**Minor Revision Sequence**  
A = 1st Generation

**Major Revision Sequence**  
1 = 1st Generation

**Voltage**  
P = 208/230V-1phase-60hz

**Low NO<sub>x</sub>**  
X = Units meet California Nitrogen Oxides standards (blank if standard model)

**Nominal Heating Capacity Input**  
072 = 72,000 Btuh  
090 = 90,000 Btuh  
108 = 108,000 Btuh  
126 = 126,000 Btuh

## FEATURES

### CONTENTS

Blower Data .....	11
Cooling Ratings .....	9
Dimensions - Accessories.....	13
Dimensions - Unit .....	12
Electrical Data.....	6
Features.....	2
Field Wiring.....	8
High Altitude Derate.....	8
Installation Clearances .....	11
Minimum Clearance To Combustible Material .....	11
Model Number Identification .....	1
Optional Accessories .....	7
Specifications.....	6
Specifications - Gas Heat .....	8

### WARRANTY

**Heat Exchanger** - Twenty year limited warranty in residential applications and ten years in non-residential applications.

**Compressor** - Ten year limited warranty in residential installations and five year in non-residential installations.

**All other covered components** - Five years in residential installations and one year in non-residential installations.

Refer to Lennox Equipment Limited Warranty certificate included with unit for specific details.

### APPLICATIONS

Designed for outdoor installations at ground level or rooftop for residential applications.

#### Zoning Applications

Units are not approved for zoning applications.

### APPROVALS

AHRI Certified to AHRI Standard 210/240-2008.

Units are design certified by ETL Intertek.

Heating ratings are according to Department of Energy (DOE) test procedures and Federal Trade Commission (FTC) labeling regulations and are Certified by AHRI.

“X” models are approved by the California Energy Commission and meet California Nitrogen Oxides Standard (NOx) limits of 40 ng/J.

Cooling system rated according to DOE test procedures.

Units are ETL certified for the U.S. and Canada.

Packaged unit and components within bonded for grounding to meet safety standards required by UL.

Each unit test operated at the factory before shipment ensuring dependable operation at start-up.

### HEATING SYSTEM

#### Heat Exchanger

Aluminized tubular steel for superior resistance to corrosion and oxidation.

Round surfaces create minimum air resistance and allow air to surround all surfaces for excellent heat transfer.

Compact design reduces space requirements in unit cabinet.

Heat exchanger has been laboratory life cycle tested.

#### Inshot Burners

Aluminized steel inshot burners provide efficient trouble free operation.

Burner venturi mixes air and gas in correct proportion for proper combustion.

Burner assembly is removable from the unit as a single component for ease of service and each burner may be removed individually.

#### Two-Stage Gas Control Valve

24 volt redundant combination two-stage gas control valve combines manual shut off valve (On-Off), automatic electric valve (dual) and gas pressure regulation into a compact combination control.

#### Two-Stage Combustion Air Inducer

Heavy duty combustion air inducer prepurges heat exchanger and safely vents flue products.

Blower is controlled by the ignition control board.

Pressure switch proves blower operation before allowing gas valve to open.

Combustion air inducer operates during heating cycle.

Inducer also operates for the first 10 seconds of every cooling cycle to prevent insects from nesting in the flue outlet during cooling season.

#### Limit Controls

Automatic reset, primary limit is accurately located.

Primary limit factory installed on heating vestibule panel on all units.

#### Flame Rollout Switch

Manual reset switch is factory installed on burner box.

Switch provides protection from abnormal operating conditions.

#### Ignition Control Board

Ignition control board with LED diagnostics.

### Optional Accessories

#### LPG/Propane Conversion Kit

Required for field changeover from natural gas to LPG/Propane.

## FEATURES

### REFRIGERATION SYSTEM

#### R-410A Refrigerant

Non-chlorine, ozone friendly, R-410A.

Unit pre-charged with refrigerant.

See Specification table.



#### Evaporator and Condenser Coils

Copper tube with aluminum fin coils.

#### Anti-Microbial Evaporator Coil Drain Pan



Anti-Microbial additive resists growth of mold and mildew on drain pan which improves indoor air quality and reduces drain line blockage.

Includes drain pan overflow switch. Monitors condensate level in drain pan, shuts down unit if drain becomes clogged.

#### Condenser Fan

Weather protected heavy duty condenser fan motor with coated steel fan blades for long life.

Internally mounted.

Totally enclosed motor.

Fan guard constructed of corrosion-resistant coated steel.

#### High Pressure Switch

Shuts off unit if abnormal operating conditions cause the discharge pressure to rise above setting.

Protects compressor from excessive condensing pressure. Automatic reset.

#### Loss of Charge Switch

Shuts off unit if suction pressure falls below setting.

Provides loss of charge and freeze-up protection.

### SCROLL COMPRESSOR

#### Copeland Scroll Ultra Tech™ Two-Stage Compressor

Compressor features high efficiency with uniform suction flow, constant discharge flow, high volumetric efficiency and quiet operation.

Compressor consists of two involute spiral scrolls matched together to generate a series of crescent shaped gas pockets between them.

During compression, one scroll remains stationary while the other scroll orbits around it.

Gas is drawn into the outer pocket, the pocket is sealed as the scroll rotates.

As the spiral movement continues, gas pockets are pushed to the center of the scrolls. Volume between the pockets is simultaneously reduced.

When the pocket reaches the center, gas is now at high pressure and is forced out of a port located in the center of the fixed scrolls. During compression, several pockets are compressed simultaneously resulting in a smooth continuous compression cycle.

Continuous flank contact, maintained by centrifugal force, minimizes gas leakage and maximizes efficiency. Scroll compressor is tolerant to the effects of slugging and contaminants. If this occurs, scrolls separate, allowing liquid or contaminants to be worked toward the center and discharged.

During the compression process, there are several pockets in the scroll that are compressing gas. Modulation is achieved by venting a portion of the gas in the first suction pocket back to the low side of the compressor thereby reducing the effective displacement of the compressor.

A 24-volt DC solenoid valve inside the compressor controls staging. When the 3-way solenoid is energized it moves the lift ring assembly to block the ports and the compressor operates at full-load or 100% capacity. When the solenoid is de-energized the lift ring assembly moves to unblock the compressor ports and the compressor operates at part-load or approximately 67% of its full-load capacity.

The “loading” and “unloading” of the two stage scroll is done “on the fly” without shutting off the single-speed compressor motor between stages.

Low gas pulses during compression reduces operational sound levels.

Compressor motor is internally protected from excessive current and temperature.

Compressor is installed in the unit on specially formulated, resilient rubber mounts for better sound dampening and vibration free operation.

### Optional Accessories

#### Compressor Crankcase Heater

Protects against refrigerant migration that can occur during low ambient operation.

#### Compressor Hard Start Kit

Single-phase units are equipped with a PSC compressor motor. This type of motor normally doesn't need a potential relay and start capacitor.

In conditions such as low voltage, this kit may be required to increase the compressor starting torque.

#### Compressor Timed-Off Control

Prevents compressor short-cycling and allows time for suction and discharge pressure to equalize. Permits compressor start-up in an unloaded condition. Automatic reset with 5 minute delay between compressor shut-off and start-up.

## FEATURES

### SUPPLY AIR BLOWER

#### Variable Speed Direct Drive Blower

Each blower wheel statically and dynamically balanced.

Multi-speed operation is achieved by the use of an ECM (Electronically Commutated Motor) variable speed motor.

See Blower Performance tables.

Blower assembly easily removed for servicing.

#### ECM Variable Speed Blower Motor

Variable speed motor maintains specified air volume from 0 though 0.80 in. w.g. static range.

Motor is controlled by the blower control.

Change in blower speed is easily accomplished by simple jumper pin change on blower control.

Motor is resiliently mounted.

### CONTROLS

#### Electronic Blower Control

Two stages - HEAT and COOL (with four different air volume selections for each) are made by simple jumper pins.

ADJUST jumper pin allows approximately 10% higher, normal or 10% lower motor speed selection within (COOL) speeds selected for for fine tuning air volume. See Blower Data tables.

*NOTE - HEAT speeds are not affected by jumper change.*

Cooling Airflow Ramp Up - At the beginning of a call for cooling, the blower will run at 82% of full airflow for 7.5 minutes. This improves the system's moisture removal and saves blower power during cooling start.

Reduced Airflow Operation - For situations where humidity control is an issue, the variable speed motor can be connected to operate at a 25% reduction in the normal airflow rate. The variable speed motor interface provides for connection of a thermostat with humidity control or a humidistat on the HUM terminal. When connected, the dehumidifier resistor on the interface must be cut. The control should be wired to open during high humidity, which will reduce blower airflow.

#### 24 Volt Transformer

40VA transformer furnished and factory installed in control area.

### Optional Accessories

#### iComfort® Equipment Interface Module (EIM)

Allows iComfort® Thermostats to be used with residential packaged units.

Contains all necessary relays and controls to operate the system and communicate with the iComfort® Thermostat.



**NOTE - The iComfort® Equipment Interface Module is required for proper operation of iComfort® Thermostats with residential packaged units.**

#### iComfort® S30 Thermostat

The iComfort® S30 Thermostat recognizes and connects conventional heating/cooling products to automatically configure and control the system (based on user-specified settings) for the highest level of comfort, performance and efficiency.



Wi-Fi remote temperature monitoring and adjustment through a home wireless network for desktop PCs, laptops and apps for smartphones or tablets. Also displays service alerts and reminders.

A simple easy-to-use touchscreen allows complete system configuration. Scheduled maintenance alerts, system warnings and troubleshooting are also displayed on thermostat screen.

One-Touch Away Mode - A quick and easy way to set the cooling and heating setpoints while away.

Weather-On-Demand - Live up-to-date weather data and five-day forecasts.

Easy to read 7 in. high definition color display (measured diagonally).

High Definition Color Display, Mag-Mount, Smart Hub Controller, wallplate (for retrofit installations) furnished for easy installation.

See the iComfort® S30 Thermostat Product Specifications bulletin in the Controls section for more information.

#### iComfort Wi-Fi® Thermostat

The iComfort Wi-Fi® Thermostat recognizes and connects conventional heating/cooling products to automatically configure and control the system (based on user-specified settings) for the highest level of comfort, performance and efficiency.



Wi-Fi remote temperature monitoring and adjustment through a home wireless network for desktop PCs, laptops and apps for smartphones or tablets. Also displays service alerts and reminders.

A simple easy-to-use touchscreen allows complete system configuration. Scheduled maintenance alerts, system warnings and troubleshooting are also displayed on thermostat screen.

One-Touch Away Mode - A quick and easy way to set the cooling and heating setpoints while away.

Weather-On-Demand - Live up-to-date weather data and five-day forecasts.

Easy to read 7-inch color screen (measured diagonally).

See the iComfort Wi-Fi® Thermostat Product Specifications bulletin in the Controls section for more information.



## FEATURES

### CONTROLS (CONTINUED)

#### Optional Accessories (continued)

##### ComfortSense® 7500 Touchscreen Thermostat

Electronic 7-day, universal, multi-stage, programmable, touchscreen thermostat.

4 Heat/2 Cool.

Auto-changeover.


Dual-fuel control with optional outdoor sensor.

Controls dehumidification during cooling mode and humidification during heating mode.

Offers enhanced capabilities including humidification / dehumidification / dewpoint measurement and control, Humiditrol® control, and equipment maintenance reminders.

Easy-to-use, menu driven thermostat with a back-lit, LCD touchscreen.

See the ComfortSense® 7500 Product Specifications bulletin in the Controls section for more information.



##### Remote Outdoor Temperature Sensor for ComfortSense® 7500 Thermostat

Allows the thermostat to display outdoor temperature. Required in dual-fuel and Humiditrol® applications.

##### Thermostat

See Thermostat bulletins in Controls section and Lennox Price Book for a complete list of thermostats.

### CABINET

Conditioned areas insulated with foil faced insulation to minimize heat loss and reduce operating sound levels.

Powder paint for maximum durability.

Easy service access.

Steel louvered panels provides complete coil protection.

##### Airflow Choice

Units are shipped in horizontal configuration and can be field converted to downflow (vertical) airflow with optional Downflow Conversion Kit.

##### Gas Piping Inlets, Electrical Inlets and Service Valves

Gas piping and field wiring inlets are located in one central area of the cabinet. See dimension drawing.

Gauge ports located inside compressor service compartment of the cabinet.

### Optional Accessories

#### Downflow Conversion Kit

Required for field conversion to downflow (vertical) air. Kit consists of 2 duct covers to block off horizontal air openings on side of unit.

#### Lifting Brackets

Available to facilitate rigging of the unit.

#### Clip Curb (Full Perimeter)

Mates to unit.

Roof curb can be assembled using interlocking tabs to fasten corners together. No tools required.

Available in 8 and 14 inch heights.

Shipped knocked down.

#### Adjustable Pitch Roof Curb (Full Perimeter)

Fully adjustable pitch curb provides a level platform for packaged units allowing flexible installations on roofs with sloped or uneven angles.

Adjustable from 2/12 to 6/12 pitch.

Unit hold-down brackets secure packaged unit to curb.

Constructed of heavy-gauge galvanized steel with fully welded seams and corners.

Rounded corners on flange prevent damage to roof shingles.

Built-in drip edge.

IAPMO/UMC listed.

CBC 2013 compliant (California).

Seismic rating - Ss=3.73 Ip=1.5, wind rating - 155mph.

Maximum load rating – 800 lbs.

### INDOOR AIR QUALITY

#### Healthy Climate® PCO Accessory

The *Healthy Climate*® PCO Accessory uses photocatalytic oxidation (PCO) technology to significantly reduce levels of airborne volatile organic compounds, cooking odors, common household odors, airborne dust particles, mold spores and pollen.

Lennox' *Healthy Climate*® PCO Accessory is mounted internally to the unit cabinet for superior indoor air quality.

Kit contains PCO cartridge, UVA lamp, UVA lampholder assembly, ballast box, wiring harness and all necessary hardware.

#### Internal Filter Rack Kits

Available for 1 in. thick filters. Kit contains filter rails for mounting filters internal to unit. Filters are not furnished and must be field provided.

*NOTE - The Internal Filter Rack Kit cannot be used with the Healthy Climate® PCO Accessory.*

*NOTE - Maximum acceptable filter efficiency is MERV 11.*

## SPECIFICATIONS

General Data		Model No.	LRP16GE24	LRP16GE36	LRP16GE48	LRP16GE60
Nominal Tonnage			2	3	4	5
Gas Heat Available - See Page 8			-72(X)	-72(X), -90(X)	-108(X)	-126(X)
Cooling Performance	Total cooling capacity - Btuh		23,800	35,400	47,500	57,000
	Total Unit Watts		1900	2950	3960	4750
	<sup>1</sup> SEER (Btuh/Watt)		16.0	16.0	16.0	16.0
	EER (Btuh/Watt)		12.5	12.0	12.0	12.0
	<sup>2</sup> Sound Rating Number (dB)		74	75	75	74
Refrigerant	Type		R-410A	R-410A	R-410A	R-410A
	Charge		5 lbs. 7 oz.	5 lbs. 12 oz.	6 lbs. 10 oz.	9 lbs. 1 oz.
Condensate drain size (fpt) - in.			3/4	3/4	3/4	3/4
Outdoor Coil	Net Face Area - sq. ft.		14.6	16.4	19.5	19.1
	Tube Dia. - in. and No. of Rows		5/16 – 1	5/16 – 1	5/16 – 1	5/16 – 2
	Fins per inch		26	26	26	22
Outdoor Coil Fan	Motor horsepower		1/6	1/6	1/4	1/4
	Dia. - in. and No. of blades		22 – 3	22 – 3	24 – 3	24 – 3
Indoor Coil	Net Face Area - sq. ft.		4.4	4.4	6.8	6.8
	Tube Dia. - in. and No. of rows		3/8 – 3	3/8 – 3	3/8 – 3	3/8 – 3
	Fins per in.		15	15	15	15
Indoor Blower	Blower wheel size dia. x width - in.		10 x 6	10 x 8	10 x 10	12 x 9
	Motor horsepower		1/2	1/2	3/4	1
Net weight of basic unit - lbs.			375	384	486	522
Shipping weight of basic unit (1 Pkg.) - lbs.			445	456	528	595
Electrical characteristics (60 hz)			208/230V-1ph-60Hz			

## ELECTRICAL DATA

Line voltage data - 60hz 1 phase		208/230V	208/230V	208/230V	208/230V
<sup>3</sup> Maximum overcurrent protection (amps)		25	35	50	60
<sup>4</sup> Minimum Circuit Ampacity		17.0	22.7	31.2	41.7
Compressor	Rated load amps	11.7	15.3	21.2	28.8
	Locked rotor amps	58.3	83.0	104.0	152.9
Outdoor Coil Fan Motor	Full load amps	1.0	1.0	1.7	1.7
	Locked rotor amps	1.9	1.9	3.2	3.2
Indoor Blower Motor	Full load amps	1.1	2.3	3.1	4.0
	Locked rotor amps	4.3	4.3	6.8	9.1

NOTE-Extremes of operating range are plus and minus 10% of line voltage.

<sup>1</sup> AHRI Certified to AHRI Standard 210/240; 95°F outdoor air temperature, 80°F db/67°F wb entering evaporator air.

<sup>2</sup> Sound Rating Number rated in accordance with test conditions included in AHRI Standard 270.

<sup>3</sup> HACR type circuit breaker or fuse.

<sup>4</sup> Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.

## OPTIONAL ACCESSORIES - ORDER SEPARATELY

Model No.		LRP16GE24	LRP16GE36	LRP16GE48	LRP16GE60
Compressor Crankcase Heater	11X27	•	•	•	•
Compressor Hard Start Kit	10J42	•	•		
	12J90			•	•
Compressor Timed-Off Control	47J27	•	•	•	•
Downflow Conversion Kit	11U80	•	•		
	11U81			•	•
<sup>1,2</sup> Internal Filter Rack Kit (Filters not furnished)	(1) 20 x 20 + (1) 14 x 20 11U73	•	•		
	(2) 20 x 20 11U74			•	•
Lifting Brackets	11U76	•	•	•	•
Clip Curbs	8 in. Height 14W71	•	•		
	14W72			•	•
	14 in. Height 14V68	•	•		
	14V69			•	•
Adjustable Pitch Roof Curb	Y7975	•	•		
	Y7976			•	•
<sup>2</sup> Healthy Climate® PCO Accessory	Y7960	•	•	•	•

## MAINTENANCE SUPPLIES - ORDER SEPARATELY

Healthy Climate® PCO Accessory Maintenance Kit (Includes PureAir™ Cartridge and UVA lamp)	Y7972	•	•	•	•
---	-------	---	---	---	---

## CONTROLS - ORDER SEPARATELY

iComfort® S30 Thermostat	12U67	•	•	•	•
iComfort Wi-Fi® Thermostat	10F81	•	•	•	•
Equipment Interface Module (EIM) - Required with iComfort thermostat	10T50	•	•	•	•
ComfortSense® 7500 Thermostat	13H14	•	•	•	•
<sup>3</sup> Outdoor Air Temperature Sensor	X2658	•	•	•	•
<sup>4</sup> Discharge Air Temperature Sensor	88K38	•	•	•	•

<sup>1</sup> Filters are not furnished and must be field provided. Maximum acceptable filter efficiency is MERV 11.

<sup>2</sup> Filter Rack Kit cannot be used with the Healthy Climate® PCO Accessory.

<sup>3</sup> Remote Outdoor Temperature Sensor is used with residential packaged units. Allows the thermostat to display outdoor temperature.

<sup>4</sup> Used with the iComfort® S30 and iComfort Wi-Fi® Thermostats for optional service diagnostics

## SPECIFICATIONS - GAS HEAT

General Data		Model No.	LRP16GE24 LRP16GE36	LRP16GE36	LRP16GE48	LRP16GE60
		Heating Input	-072	-090	-108	-126
Heating Capacity Btuh	First Stage - Input		54,000	67,500	81,000	94,500
	Output		43,500	54,500	65,500	76,500
	Second Stage - Input		72,000	90,000	108,000	126,000
	Output		58,000	73,000	88,000	102,000
<sup>1</sup> AFUE			81%	81%	81%	81%
Temperature Rise - °F	First Stage		35 - 45	35 - 45	45 - 55	45 - 55
	Second Stage		45 - 55	45 - 55	50 - 60	50 - 60
Gas Supply Connection (FPT) - in.			1/2	1/2	1/2	1/2
Min. Recommended Gas Supply Pressure		5 in. w.g. Natural Gas, 11 in. w.g. LPG/Propane				

## OPTIONAL ACCESSORIES - ORDER SEPARATELY

LPG/Propane Conversion Kit	15C55	15C55	15C55	15C55
----------------------------	-------	-------	-------	-------


<sup>1</sup> Annual Fuel Utilization Efficiency based on U.S. DOE test procedures and FTC labeling regulations.

## HIGH ALTITUDE DERATE

Units may be installed at altitudes up to 4500 feet above sea level without any modification. At altitudes above 4500 feet, units must be derated 4% for every 1000 feet above sea level. Example - At an altitude of 6000 feet the unit would require a derate of 24%.

NOTE - This is the only permissible derate for these units.

## FIELD WIRING

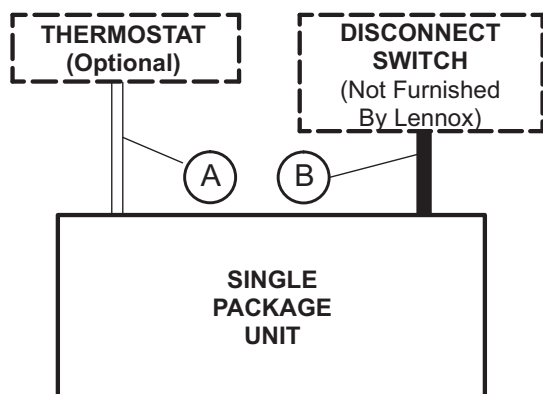

A – Seven Wire Low Voltage (Electronic)

B – Two Wire Power (See Electrical Data Table)

– Field Wiring Not Furnished –



## COOLING RATINGS

### 2 TON - LRP16GE24 (1ST STAGE)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																							
		65°F						75°F						85°F						95°F					
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)						
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb						
				cfm	kBtuh	kW			75°F	80°F	85°F			kBtuh	kW	75°F			80°F	85°F	kBtuh	kW	75°F	80°F	85°F
63°F	500	20.4	7.3	0.72	0.85	0.99	19.3	8.4	0.73	0.87	1.00	18.3	9.7	0.75	0.90	1.00	17.2	11.2	0.77	0.93	1.00				
	560	20.9	7.3	0.74	0.89	1.00	19.8	8.4	0.76	0.91	1.00	18.8	9.7	0.77	0.94	1.00	17.6	11.2	0.80	0.98	1.00				
	610	21.3	7.2	0.76	0.92	1.00	20.1	8.4	0.78	0.95	1.00	19.0	9.6	0.80	0.98	1.00	17.9	11.1	0.82	1.00	1.00				
67°F	500	21.9	7.2	0.56	0.69	0.82	20.7	8.3	0.57	0.71	0.84	19.6	9.6	0.58	0.72	0.87	18.5	11.1	0.59	0.74	0.89				
	560	22.3	7.1	0.58	0.72	0.86	21.1	8.2	0.59	0.74	0.88	19.9	9.5	0.60	0.76	0.90	18.8	11.0	0.61	0.78	0.94				
	610	22.7	7.1	0.59	0.74	0.89	21.4	8.2	0.60	0.76	0.92	20.1	9.5	0.62	0.78	0.95	19.0	11.0	0.63	0.81	0.98				
71°F	500	23.4	7.0	0.42	0.55	0.66	22.2	8.1	0.43	0.55	0.68	20.9	9.4	0.43	0.57	0.70	19.8	10.9	0.43	0.58	0.72				
	560	23.9	7.0	0.43	0.56	0.69	22.6	8.1	0.43	0.57	0.71	21.3	9.4	0.44	0.59	0.73	20.1	10.8	0.44	0.60	0.75				
	610	24.2	6.9	0.43	0.58	0.72	22.9	8.0	0.44	0.59	0.74	21.6	9.3	0.44	0.60	0.76	20.4	10.8	0.45	0.62	0.78				

### 2 TON - LRP16GE24 (2ND STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		85°F					95°F					105°F					115°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
				cfm	kBtuh	kW			75°F	80°F	85°F			kBtuh	kW	75°F			80°F	85°F	kBtuh
63°F	600	23.9	15.9	0.72	0.86	1.00	22.6	17.5	0.74	0.88	1.00	21.4	19.6	0.75	0.91	1.00	20.0	21.7	0.77	0.94	1.00
	800	25.2	16.0	0.80	0.97	1.00	23.9	17.6	0.81	1.00	1.00	22.7	19.6	0.83	1.00	1.00	21.5	21.8	0.85	1.00	1.00
	1000	26.6	16.1	0.86	1.00	1.00	25.3	17.7	0.88	1.00	1.00	24.0	19.6	0.90	1.00	1.00	22.7	21.9	0.93	1.00	1.00
67°F	600	25.5	16.0	0.57	0.70	0.83	24.2	17.6	0.58	0.71	0.85	22.8	19.5	0.59	0.73	0.88	21.4	21.9	0.60	0.75	0.90
	800	26.8	16.1	0.61	0.78	0.94	25.4	17.7	0.62	0.80	0.98	23.9	19.6	0.64	0.83	1.00	22.4	21.8	0.65	0.85	1.00
	1000	27.7	16.1	0.66	0.86	1.00	26.2	17.7	0.68	0.89	1.00	24.6	19.6	0.70	0.92	1.00	23.0	21.9	0.72	0.96	1.00
71°F	600	27.3	16.1	0.43	0.55	0.67	25.9	17.7	0.43	0.56	0.69	24.5	19.6	0.43	0.57	0.71	23.0	22.0	0.44	0.58	0.73
	800	28.6	16.2	0.44	0.60	0.76	27.0	17.8	0.45	0.61	0.78	25.5	19.6	0.45	0.63	0.81	23.9	21.8	0.46	0.65	0.84
	1000	29.4	16.2	0.46	0.65	0.84	27.8	17.8	0.47	0.67	0.87	26.1	19.7	0.48	0.69	0.91	24.4	21.9	0.49	0.72	1.00

### 3 TON - LRP16GE36 (1ST STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
	cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F
63°F	760	29.0	10.8	0.74	0.88	1.00	27.5	12.3	0.75	0.90	1.00	26.0	14.2	0.77	0.93	1.00	24.4	16.3	0.79	0.96	1.00
	840	29.6	10.8	0.76	0.92	1.00	28.1	12.3	0.78	0.94	1.00	26.5	14.1	0.80	0.97	1.00	25.1	16.3	0.82	1.00	1.00
	920	30.1	10.7	0.78	0.95	1.00	28.6	12.2	0.80	0.98	1.00	26.9	14.1	0.83	1.00	1.00	25.6	16.2	0.84	1.00	1.00
67°F	760	31.1	10.7	0.58	0.71	0.84	29.5	12.2	0.58	0.73	0.87	27.8	14.0	0.59	0.75	0.90	26.2	16.2	0.61	0.77	0.93
	840	31.7	10.6	0.59	0.74	0.88	30.0	12.1	0.60	0.75	0.91	28.3	14.0	0.61	0.78	0.94	26.6	16.1	0.63	0.80	0.98
	920	32.1	10.6	0.60	0.76	0.92	30.4	12.1	0.62	0.78	0.95	28.7	14.0	0.63	0.81	0.99	28.9	16.0	0.60	0.78	0.94
71°F	760	33.4	10.5	0.43	0.56	0.68	31.7	12.0	0.43	0.57	0.70	29.9	13.9	0.44	0.58	0.72	28.2	16.0	0.44	0.59	0.74
	840	33.9	10.4	0.43	0.57	0.71	32.2	11.9	0.44	0.58	0.73	30.4	13.8	0.44	0.60	0.75	28.5	16.0	0.45	0.61	0.78
	920	34.4	10.4	0.44	0.59	0.74	32.6	11.9	0.44	0.60	0.76	30.8	13.8	0.45	0.62	0.78	27.2	16.1	0.48	0.67	0.86

### 3 TON - LRP16GE36 (2ND STAGE)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		85°F					95°F					105°F					115°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
				75°F	80°F	85°F			75°F	80°F	85°F			75°F	80°F	85°F			75°F	80°F	85°F
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	1000	36.5	23.9	0.74	0.90	1.00	34.6	26.5	0.77	0.92	1.00	32.6	29.4	0.78	0.95	1.00	30.6	32.8	0.80	0.99	1.00
	1200	37.6	24.0	0.79	0.95	1.00	35.7	26.6	0.82	0.98	1.00	33.9	29.6	0.83	1.00	1.00	32.1	33.0	0.85	1.00	1.00
	1400	38.9	24.2	0.83	1.00	1.00	37.1	26.8	0.86	1.00	1.00	35.2	29.8	0.88	1.00	1.00	33.4	33.1	0.90	1.00	1.00
67°F	1000	38.9	24.2	0.58	0.73	0.87	36.9	26.8	0.59	0.74	0.89	34.8	29.7	0.60	0.76	0.92	32.7	33.1	0.62	0.79	0.96
	1200	40.0	24.3	0.61	0.78	0.95	37.9	26.9	0.63	0.80	0.98	36.0	29.8	0.63	0.82	0.98	33.4	33.1	0.66	0.86	1.00
	1400	40.6	24.4	0.65	0.83	1.00	38.6	27.0	0.66	0.86	1.00	36.3	29.9	0.68	0.90	1.00	34.1	33.2	0.70	0.93	1.00
71°F	1000	41.4	24.5	0.43	0.57	0.70	39.3	27.0	0.43	0.58	0.72	37.0	30.0	0.44	0.59	0.74	34.9	33.3	0.44	0.61	0.77
	1200	42.5	24.6	0.44	0.60	0.76	40.2	27.1	0.45	0.62	0.78	37.9	30.1	0.45	0.63	0.79	35.8	33.4	0.45	0.65	0.81
	1400	43.3	24.7	0.46	0.64	0.80	41.1	27.2	0.46	0.65	0.84	38.7	30.2	0.47	0.67	0.88	36.3	33.5	0.47	0.70	0.88

## COOLING RATINGS

### 4 TON - LRP16GE48 (1ST STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
	cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F
63°F	1010	39.3	13.8	0.73	0.87	1.00	37.0	16.1	0.75	0.90	1.00	34.7	18.7	0.77	0.93	1.00	32.3	21.6	0.79	0.97	1.00
	1120	40.1	13.7	0.75	0.91	1.00	37.7	16.0	0.77	0.94	1.00	35.3	18.7	0.80	0.97	1.00	33.2	21.5	0.82	1.00	1.00
	1230	40.7	13.6	0.78	0.95	1.00	38.4	16.0	0.80	0.98	1.00	36.0	18.6	0.82	1.00	1.00	34.0	21.4	0.84	1.00	1.00
67°F	1010	41.9	13.5	0.57	0.71	0.84	39.5	15.9	0.58	0.72	0.87	37.0	18.5	0.59	0.75	0.90	34.5	21.4	0.61	0.77	0.93
	1120	42.7	13.5	0.59	0.73	0.88	40.2	15.8	0.60	0.75	0.91	37.7	18.5	0.61	0.78	0.94	35.1	21.4	0.63	0.80	0.98
	1230	43.3	13.4	0.60	0.76	0.92	40.7	15.8	0.62	0.78	0.95	38.2	18.4	0.63	0.81	0.99	35.7	21.3	0.65	0.84	1.00
71°F	1010	44.9	13.3	0.43	0.55	0.68	42.3	15.6	0.43	0.57	0.70	39.7	18.3	0.44	0.58	0.72	37.2	21.2	0.44	0.59	0.74
	1120	45.6	13.2	0.43	0.57	0.71	43.0	15.6	0.44	0.58	0.73	40.3	18.2	0.44	0.60	0.75	37.7	21.1	0.45	0.62	0.78
	1230	46.3	13.1	0.44	0.59	0.74	43.6	15.5	0.44	0.60	0.76	40.9	18.2	0.45	0.62	0.79	38.2	21.1	0.46	0.64	0.82

### 4 TON - LRP16GE48 (2ND STAGE)

Entering Wet Bulb Temper- ature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		85°F					95°F					105°F					115°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
				cfm	kBtuh	kW			75°F	80°F	85°F			kBtuh	kW	75°F			80°F	85°F	kBtuh
63°F	1400	48.4	31.8	0.76	0.92	1.00	45.9	35.4	0.78	0.95	1.00	43.3	39.5	0.80	0.99	1.00	40.7	44.1	0.82	1.00	1.00
	1600	49.6	31.9	0.80	0.98	1.00	47.0	35.5	0.82	1.00	1.00	44.7	39.6	0.84	1.00	1.00	42.3	44.5	0.86	1.00	1.00
	1800	50.8	32.0	0.83	1.00	1.00	48.5	35.6	0.85	1.00	1.00	46.1	39.8	0.87	1.00	1.00	43.6	44.6	0.89	1.00	1.00
67°F	1400	51.6	32.1	0.59	0.74	0.89	48.8	35.7	0.60	0.76	0.92	46.0	39.8	0.62	0.79	0.95	43.2	44.6	0.63	0.81	0.99
	1600	52.6	32.2	0.62	0.79	0.96	49.8	35.8	0.63	0.81	0.99	46.8	39.9	0.65	0.84	1.00	44.0	44.7	0.66	0.87	1.00
	1800	53.4	32.3	0.64	0.83	0.99	50.5	35.8	0.66	0.86	1.00	47.6	40.0	0.67	0.89	1.00	44.6	44.8	0.70	0.92	1.00
71°F	1400	55.0	32.4	0.44	0.58	0.72	52.1	36.0	0.44	0.59	0.74	49.1	40.2	0.44	0.60	0.76	46.2	45.1	0.45	0.62	0.79
	1600	56.0	32.5	0.45	0.61	0.76	53.0	36.1	0.45	0.62	0.79	49.9	40.3	0.46	0.64	0.82	46.8	45.1	0.46	0.66	0.85
	1800	56.8	32.5	0.46	0.63	0.81	53.7	36.2	0.46	0.65	0.84	50.6	40.4	0.47	0.67	0.87	47.4	45.2	0.48	0.69	0.90

### 5 TON - LRP16GE60 (1ST STAGE)

Entering Wet Bulb Temp- erature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
	cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F
63°F	1130	46.2	17.4	0.72	0.85	0.99	43.5	20.1	0.73	0.88	1.00	40.8	23.2	0.75	0.91	1.00	38.0	26.6	0.77	0.94	1.00
	1260	47.3	17.3	0.74	0.89	1.00	44.5	20.1	0.76	0.92	1.00	41.6	23.2	0.78	0.95	1.00	38.9	26.6	0.80	0.99	1.00
	1390	48.1	17.2	0.76	0.93	1.00	45.2	20.0	0.79	0.96	1.00	42.4	23.1	0.81	0.99	1.00	39.8	26.5	0.83	1.00	1.00
67°F	1130	49.4	17.1	0.56	0.69	0.82	46.5	19.9	0.57	0.71	0.84	43.6	23.0	0.58	0.73	0.87	40.7	26.4	0.60	0.75	0.91
	1260	50.3	17.0	0.58	0.72	0.86	47.5	19.8	0.59	0.74	0.88	44.4	22.9	0.60	0.76	0.92	41.5	26.4	0.62	0.79	0.96
	1390	51.2	17.0	0.59	0.74	0.89	48.1	19.7	0.61	0.77	0.93	45.0	22.9	0.62	0.79	0.96	42.1	26.3	0.64	0.82	1.00
71°F	1130	52.8	16.8	0.43	0.55	0.66	49.8	19.6	0.43	0.56	0.68	46.8	22.7	0.43	0.57	0.70	43.7	26.2	0.44	0.58	0.73
	1260	53.8	16.7	0.43	0.56	0.69	50.7	19.5	0.43	0.57	0.71	47.5	22.7	0.44	0.59	0.73	44.5	26.1	0.44	0.60	0.76
	1390	54.6	16.6	0.44	0.58	0.72	51.4	19.4	0.44	0.59	0.74	48.2	22.6	0.45	0.61	0.77	45.0	26.0	0.45	0.63	0.80

### 5 TON - LRP16GE60 (2ND STAGE)

Entering Wet Bulb Temp- erature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		85°F					95°F					105°F					115°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
	cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F
63°F	1600	57.8	38.6	0.75	0.88	1.00	55.1	42.7	0.76	0.91	1.00	52.0	47.4	0.78	0.93	1.00	49.1	52.7	0.80	0.96	1.00
	1800	59.0	38.7	0.78	0.92	1.00	56.1	42.8	0.80	0.95	1.00	53.2	47.6	0.80	0.98	1.00	50.2	52.9	0.82	1.00	1.00
	2000	60.1	38.8	0.79	0.96	1.00	57.2	43.0	0.81	0.99	1.00	54.4	47.7	0.82	1.00	1.00	51.7	53.1	0.83	1.00	1.00
67°F	1600	61.7	39.1	0.58	0.73	0.85	58.5	43.1	0.59	0.75	0.88	55.4	47.8	0.60	0.77	0.91	52.2	53.2	0.62	0.79	0.93
	1800	62.8	39.2	0.60	0.76	0.90	59.6	43.3	0.61	0.78	0.93	56.4	48.0	0.63	0.81	0.95	53.0	53.3	0.64	0.81	0.98
	2000	63.6	39.3	0.62	0.78	0.94	60.5	43.4	0.64	0.80	0.97	57.0	48.1	0.65	0.82	1.00	53.7	53.4	0.67	0.85	1.00
71°F	1600	65.4	39.5	0.43	0.57	0.71	62.3	43.6	0.43	0.58	0.72	58.9	48.3	0.44	0.59	0.75	55.5	53.7	0.44	0.61	0.77
	1800	66.7	39.7	0.44	0.59	0.74	63.3	43.7	0.44	0.60	0.76	59.8	48.4	0.45	0.62	0.79	56.3	53.8	0.45	0.64	0.81
	2000	67.6	39.8	0.45	0.61	0.76	64.1	43.8	0.45	0.63	0.78	60.5	48.5	0.46	0.65	0.81	56.9	53.9	0.46	0.66	0.83

## BLOWER DATA

### LRP16GE24 Blower Performance

0 through 0.80 in. w.g. External Static Pressure Range

“ADJUST” Jumper Setting	Blower Control Jumper Speed Positions											
	“COOL” Speed - cfm				“HEAT” Speed - cfm				“CONTINUOUS FAN” Speed - cfm			
	A	B	C	D	A	B	C	D	A	B	C	D
+	1100	880	660	440	1100	1000	900	815	550	440	330	220
NORM	1000	800	600	400	1100	1000	900	815	500	400	300	200
—	900	720	540	360	1100	1000	900	815	450	360	270	180

NOTE - All air data is measured external to unit without air filters.

NOTE - 1st Stage airflow is 70% of 2nd Stage airflow (full capacity) in cooling mode. In heating mode, low stage airflow is optimized for a 40°F temperature rise.

### LRP16GE36 Blower Performance

0 through 0.80 in. w.g. External Static Pressure Range

“ADJUST” Jumper Setting	Blower Control Jumper Speed Positions											
	“COOL” Speed - cfm				“HEAT” Speed - cfm				“CONTINUOUS FAN” Speed - cfm			
	A	B	C	D	A	B	C	D	A	B	C	D
+	1540	1320	1100	880	1400	1200	1100	975	770	660	550	440
NORM	1400	1200	1000	800	1400	1200	1100	975	700	600	500	400
—	1260	1080	900	720	1400	1200	1100	975	630	540	450	360

NOTE - All air data is measured external to unit without air filters.

NOTE - 1st Stage airflow is 70% of 2nd Stage airflow (full capacity) in cooling mode. In heating mode, low stage airflow is optimized for a 40°F temperature rise.

### LRP16GE48 Blower Performance

0 through 0.80 in. w.g. External Static Pressure Range

“ADJUST” Jumper Setting	Blower Control Jumper Speed Positions											
	“COOL” Speed - cfm				“HEAT” Speed - cfm				“CONTINUOUS FAN” Speed - cfm			
	A	B	C	D	A	B	C	D	A	B	C	D
+	1980	1760	1540	1320	1350	1200	1100	1000	990	880	770	660
NORM	1800	1600	1400	1200	1350	1200	1100	1000	900	800	700	600
—	1620	1440	1260	1080	1350	1200	1100	1000	810	720	630	540

NOTE - All air data is measured external to unit without air filters.

NOTE - 1st Stage airflow is 70% of 2nd Stage airflow (full capacity) in cooling mode. In heating mode, low stage airflow is optimized for a 40°F temperature rise.

### LRP16GE60 Blower Performance

0 through 0.80 in. w.g. External Static Pressure Range

“ADJUST” Jumper Setting	Blower Control Jumper Speed Positions											
	“COOL” Speed - cfm				“HEAT” Speed - cfm				“CONTINUOUS FAN” Speed - cfm			
	A	B	C	D	A	B	C	D	A	B	C	D
+	2200	1980	1760	1540	1480	1380	1280	1180	1100	990	880	770
NORM	2000	1800	1600	1400	1480	1380	1280	1180	1000	900	800	700
—	1800	1620	1440	1260	1480	1380	1280	1180	900	810	720	630

NOTE - All air data is measured external to unit without air filters.

NOTE - 1st Stage airflow is 70% of 2nd Stage airflow (full capacity) in cooling mode. In heating mode, low stage airflow is optimized for a 40°F temperature rise.


## INSTALLATION CLEARANCES

	in.	mm
Front (heat exchanger access)	24	610
Right Side (blower access)	24	610
Left Side (evaporator coil access)	24	610
Back	0	0
Top	48	1219


## MINIMUM CLEARANCE TO COMBUSTIBLE MATERIAL

	in.	mm
Front	0	0
Back	0	0
Right Side (vent cover)	12	305
Left Side	0	0
Top	0	0
Below Unit	0	0


# DIMENSIONS - UNIT - INCHES (MM)



TOP VIEW



BACK VIEW




RIGHT SIDE VIEW


Model No.	A		B		C		D		E	
	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm
LRP16GE24, 36	36-7/8	937	46-3/4	1187	13-3/8	340	5-7/8	149	16-3/4	425
LRP16GE48, 60	40-7/8	1038	55-1/4	1403	18-1/8	467	4-5/8	117	19-3/4	502
Model No.	F		G		H					
	in.	mm	in.	mm	in.	mm				
LRP16GE24, 36	14	356	28-1/8	714	22-1/8	562				
LRP16GE48, 60	19-1/2	495	32-1/8	816	26-1/8	664				

## DIMENSIONS - ACCESSORIES - INCHES (MM)

### CLIP CURB



#### TYPICAL FLASHING DETAIL




NOTE - Roof deck may be omitted within confines of curb.

Usage	A		B		C		D		E	
	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm
24, 36	44-5/8	1133	43	1092	18	457	44	1118	37	940
48, 60	53-1/8	1349	51	1295	24	610	52-1/2	1334	41	1041
Usage	F		G							
	in.	mm	in.	mm						
24, 36	14	356	16-3/4	425						
48, 60	19-1/2	495	19-3/4	502						



## DIMENSIONS - ACCESSORIES - INCHES (MM)

### ADJUSTABLE PITCH ROOF CURB



Usage	A		B		C		D	
	in.	mm	in.	mm	in.	mm	in.	mm
24, 36	47	1194	34-1/2	876	5	127	33-3/4	857
42, 60	55-1/4	1403	42-3/8	1076	10	254	33	838
Model No.	E		F		G			
	in.	mm	in.	mm	in.	mm		
24, 36	14-1/2	368	18-3/4	476	18	457		
42, 60	20	508	21-1/8	537	18-1/4	464		



## REVISIONS

Sections	Description of Change
Dimensions - Accessories	Updated opening dimensions.
Features	Updated to include Zoning Applications.



Visit us at [www.lennox.com](http://www.lennox.com)

For the latest technical information, [www.LennoxPros.com](http://www.LennoxPros.com)

Contact us at 1-800-4-LENNOX

NOTE - Due to our ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

©2016 Lennox Industries, Inc.